


- ① 8-3/4" MINIMUM; 11-3/4" MAXIMUM (3/4" AND 1" METERS)
9-1/2" MINIMUM; 12-1/2" MAXIMUM (1-1/2" METER)

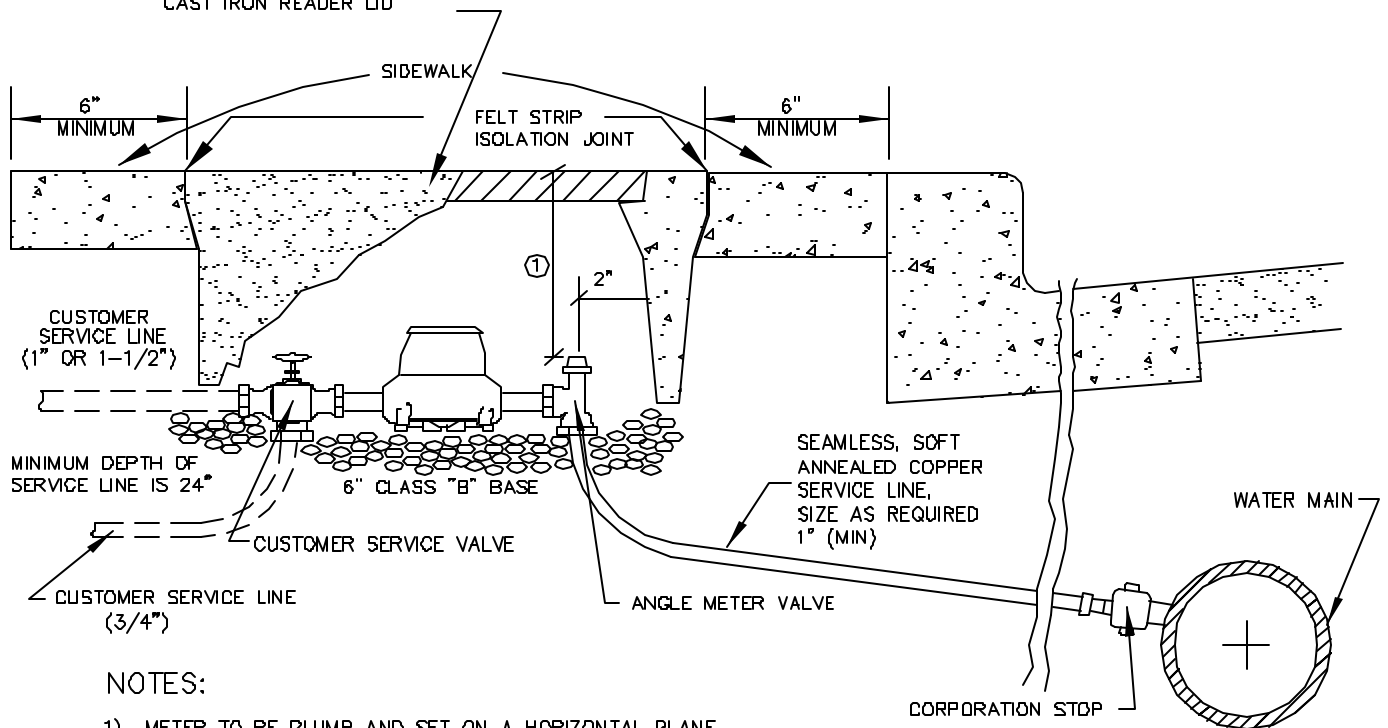

NOTES:

- 1) METER TO BE PLUMB AND SET ON A HORIZONTAL PLANE.
- 2) METER TO BE CENTERED EACH WAY INSIDE METER BOX.
- 3) METER BOXES SET IN TRAFFIC AREAS SHALL HAVE TRAFFIC LIDS.
- 4) METER BOXES SET OUTSIDE OF PAVED AREAS SHALL BE PLACED IN A 5' X 5' CONCRETE PAD.
- 5) WHEN PLACED IN SIDEWALK, MAINTAIN 6" MINIMUM CONCRETE AROUND THE METER BOX PERIMETER.
- 6) FOR 2" METERS SEE DETAIL NO. 306A

CITY OF CORVALLIS

ENGINEERING DIVISION

3/4", 1" & 1-1/2" WATER METER SETTING

DATE: JULY, 2005

SCALE: NONE

STANDARD DETAIL No.

APPROVED:

306